


**UNDERGROUND SERVICE TO UTILITY POLE**

**NOTES:**

1. THE PUD PREFERS THE CUSTOMER CONDUIT STUB UP LOCATION TO BE LOCATED NEXT TO THE UTILITY METER AS SHOWN IN THIS SCHEMATIC. HOWEVER, THE CUSTOMER MAY RUN CONDUIT TO ANY LOCATION OUTSIDE OF THE HOUSE PROVIDED THE FINAL CABLE LENGTH FROM THE UTILITY POLE TO THE STUB UP LOCATION OUTSIDE THE HOUSE (NEAR THE UTILITY METER) DOES NOT EXCEED 250 FEET.
2. IF THERE ARE NO EXISTING STANDOFF BRACKETS, ON THE POWER POLE, INSTALL CONDUIT WITHIN 6" - 8" OF THE POLE.

**ROADWAY**

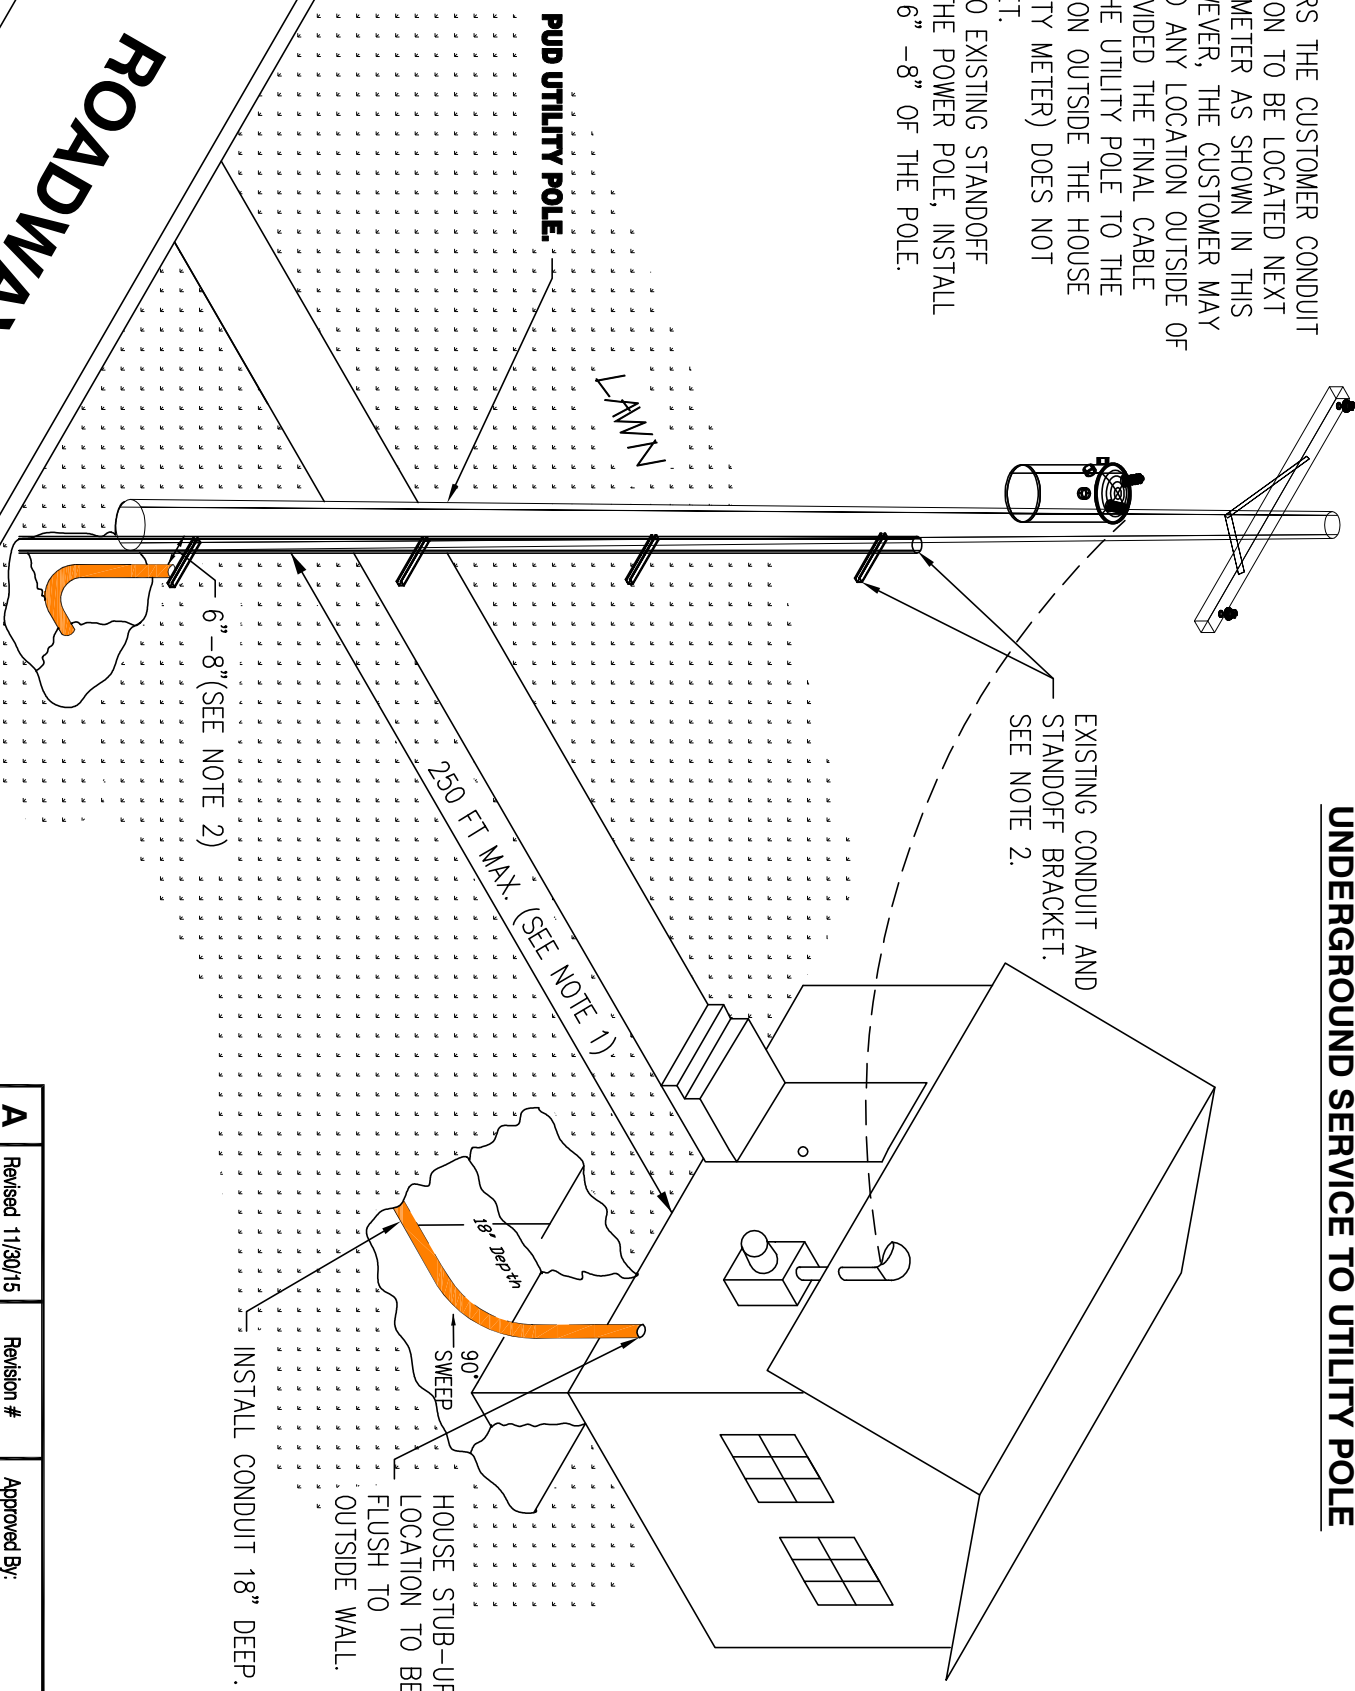

<b>A</b>	Revised 11/30/15	Revision #	Approved By:
----------	------------------	------------	--------------

**STANDARD DETAILS**

**FIBER CONDUIT TO UTILITY POLE LAYOUT**

Drawing is NOT to scale

**A-05**